



Detect Free Water in Aviation Fuel

FEATURES

- **Easy to Use** – Automatically controls the sample size. Simple evaluation by color comparison.
- **Shelf Life** – For details on shelf life refer to date on box or contact Velcon at 1-800-531-0180.
- **Responds Consistently** – Responds consistently in a wide variety of aviation jet fuels.
- **Carefully Controlled Quality** – Manufactured by Velcon Filters, Inc. to strict quality control specifications.


DESCRIPTION

The HYDROKIT is an effective “Go, No-Go” field test designed to periodically check for free water, which is removed to ppm levels by properly operating filter/separators, **Aquacon®**, and monitor vessels. Samples are normally taken downstream of the vessel, but they can also be taken at other points in the fuel distribution system.

The HYDROKIT is designed to indicate free water in excess of 30* ppm by changing the powder contained in the sample tube to a pink color. Thirty ppm is generally accepted as the maximum amount of water permissible when fueling aircraft. The HYDROKIT is designed for “fail-safe” operation, with false negative readings unlikely. Almost any error in performing the test will indicate the presence of wet fuel. If the sample indicates the presence of excessive water, it is always a good practice to repeat the test on a second sample.

APPLICATIONS

- Aviation Jet (Turbine) Fuels
- Diesel Fuel
- Not for use with Avgas

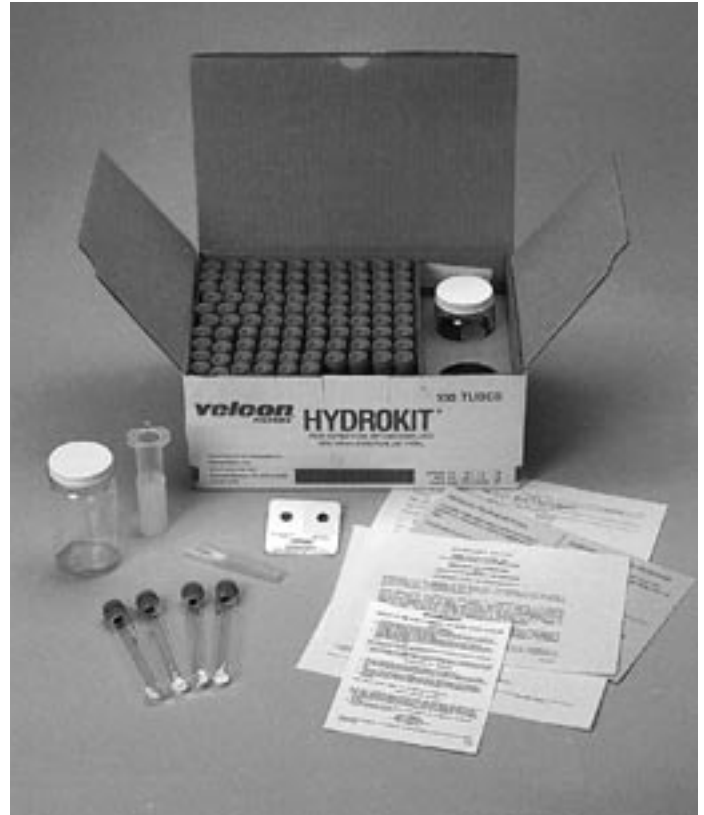

ORDERING INFORMATION

<u>MODEL NO.</u>	<u>QTY OF TEST TUBES</u>	
HK600*	600	(6 ea. HK100)
HK600-15	600	(6 ea. HK100-15 15 ppm sensitivity)
HK100*	100	
HK100-15	100	(15 ppm sensitivity)
HK25	25	
HK25-15	25	(15 ppm sensitivity)
HK3	3	
HK3-15	3	(15 ppm sensitivity)

Each model above comes complete with:
 sample tubes
 wide mouth glass sample jar(s)
 needle holder assembly
 instruction card
 color indicator comparison card

*in excess of 15 ppm in HKxx-15 tubes. These tubes are used where ATA-103 requirements are specified at 15 ppm of water maximum.

How To Use HYDROKIT®

- 1**
Sample bottle
must be clean.



- 2**
Take sample
downstream of
vessel.



- 3**
Push tube down
into needle holder
in sample.



- 4**
After tube fills,
shake for
15 seconds.
Set upright
to allow powder
to settle.



- 5**
Check powder
color at
two minutes.



- 6**
If color is the
same or darker
than FAIL,
more than
30* ppm
of free water
is present.



*(15 ppm of free water
in HKxxx-15 tubes.)

Velcon

Velcon products are sold and serviced by a world-wide representative network. To order, contact Headquarters or your **LOCAL REPRESENTATIVE**:

COMPANY HEADQUARTERS:
Velcon Filters, Inc.
1210 Garden of the Gods Road
Colorado Springs, CO 80907-3410
Phone: 1.800.531.0180 / 1.719.531.5855
Fax: 719.531.5690
e-mail: vfsales@velcon.com
www.velcon.com

MANUFACTURING PLANTS LOCATED AT:
Colorado Springs, Colorado
Sylacauga, Alabama

OVERSEAS AFFILIATES:
Frankfurt/M., Germany & Singapore

**Liquid Filtration
and Separation
Specialists**